

Water Servicing Corridors

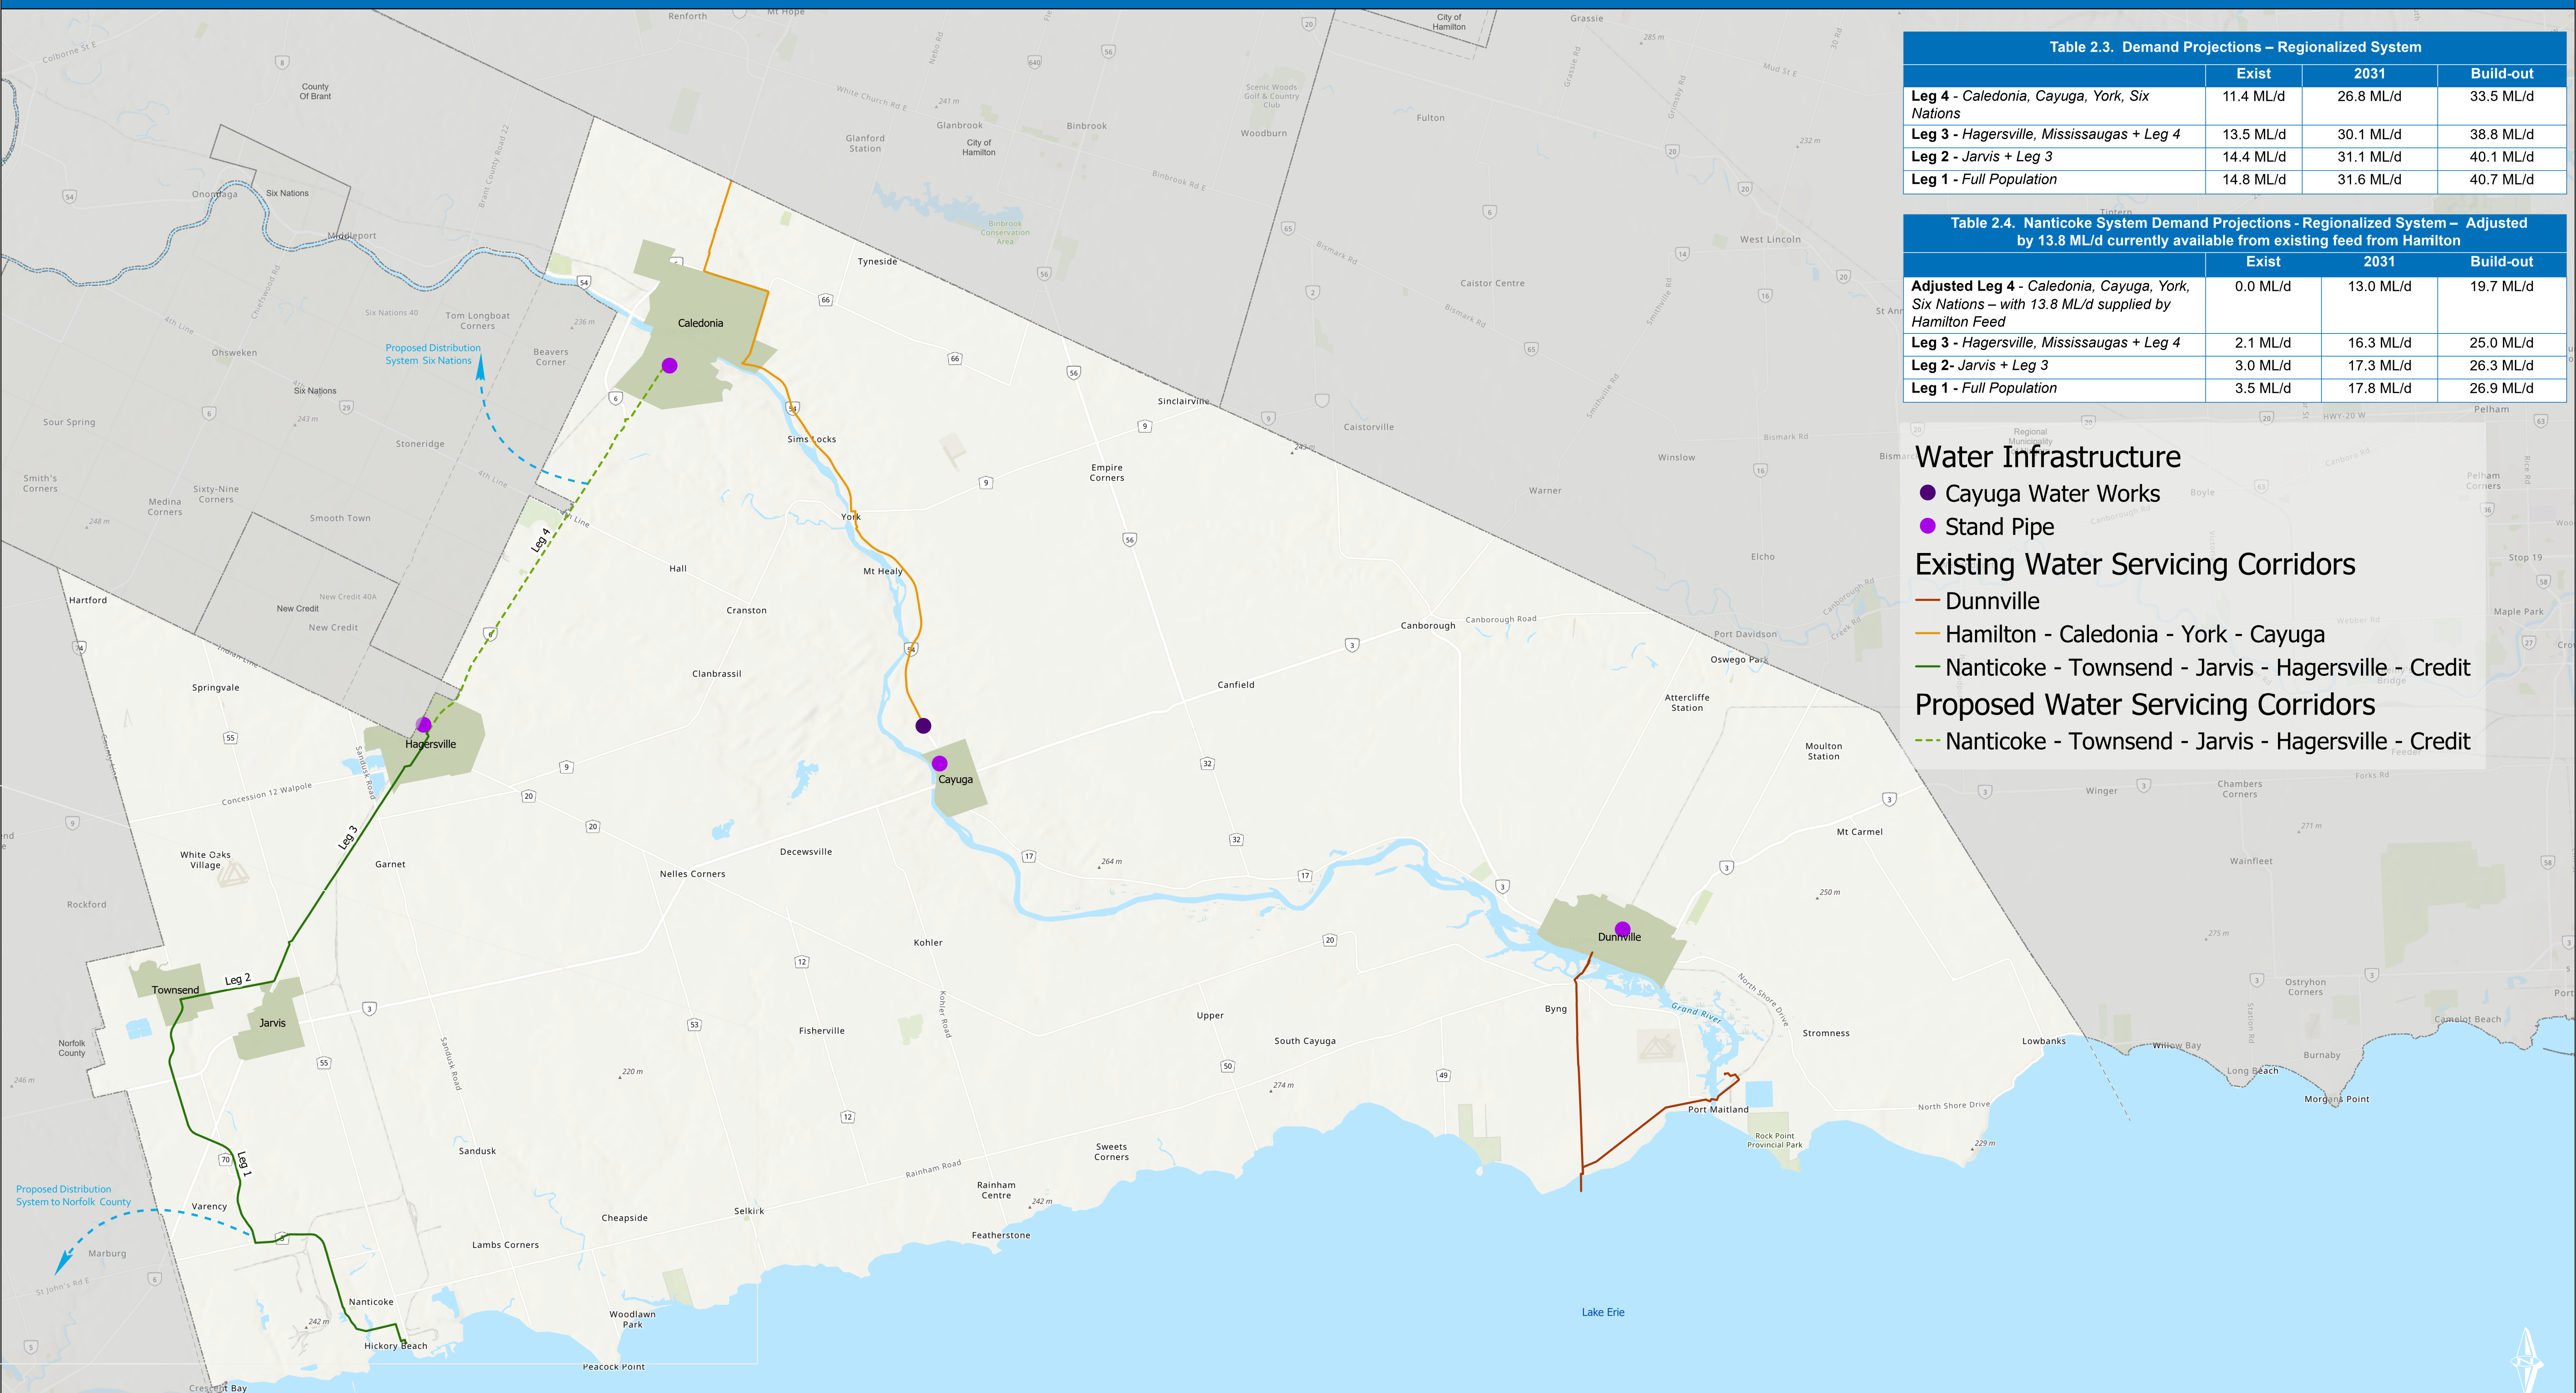


Table 2.3. Demand Projections – Regionalized System

	Exist	2031	Build-out
Leg 4 - Caledonia, Cayuga, York, Six Nations	11.4 ML/d	26.8 ML/d	33.5 ML/d
Leg 3 - Hagersville, Mississaugas + Leg 4	13.5 ML/d	30.1 ML/d	38.8 ML/d
Leg 2 - Jarvis + Leg 3	14.4 ML/d	31.1 ML/d	40.1 ML/d
Leg 1 - Full Population	14.8 ML/d	31.6 ML/d	40.7 ML/d

Table 2.4. Nanticoke System Demand Projections - Regionalized System – Adjusted by 13.8 ML/d currently available from existing feed from Hamilton

	Exist	2031	Build-out
Adjusted Leg 4 - Caledonia, Cayuga, York, Six Nations – with 13.8 ML/d supplied by Hamilton Feed	0.0 ML/d	13.0 ML/d	19.7 ML/d
Leg 3 - Hagersville, Mississaugas + Leg 4	2.1 ML/d	16.3 ML/d	25.0 ML/d
Leg 2 - Jarvis + Leg 3	3.0 ML/d	17.3 ML/d	26.3 ML/d
Leg 1 - Full Population	3.5 ML/d	17.8 ML/d	26.9 ML/d

Water Infrastructure

- Cayuga Water Works
- Stand Pipe

Existing Water Servicing Corridors

- Dunnville
- Hamilton - Caledonia - York - Cayuga
- Nanticoke - Townsend - Jarvis - Hagersville - Credit

Proposed Water Servicing Corridors

- - - Nanticoke - Townsend - Jarvis - Hagersville - Credit